

Fig. 1

APPROVED	C.G. FIG.
BY	CLASS
DRAFTSMAN	SUBCLASS


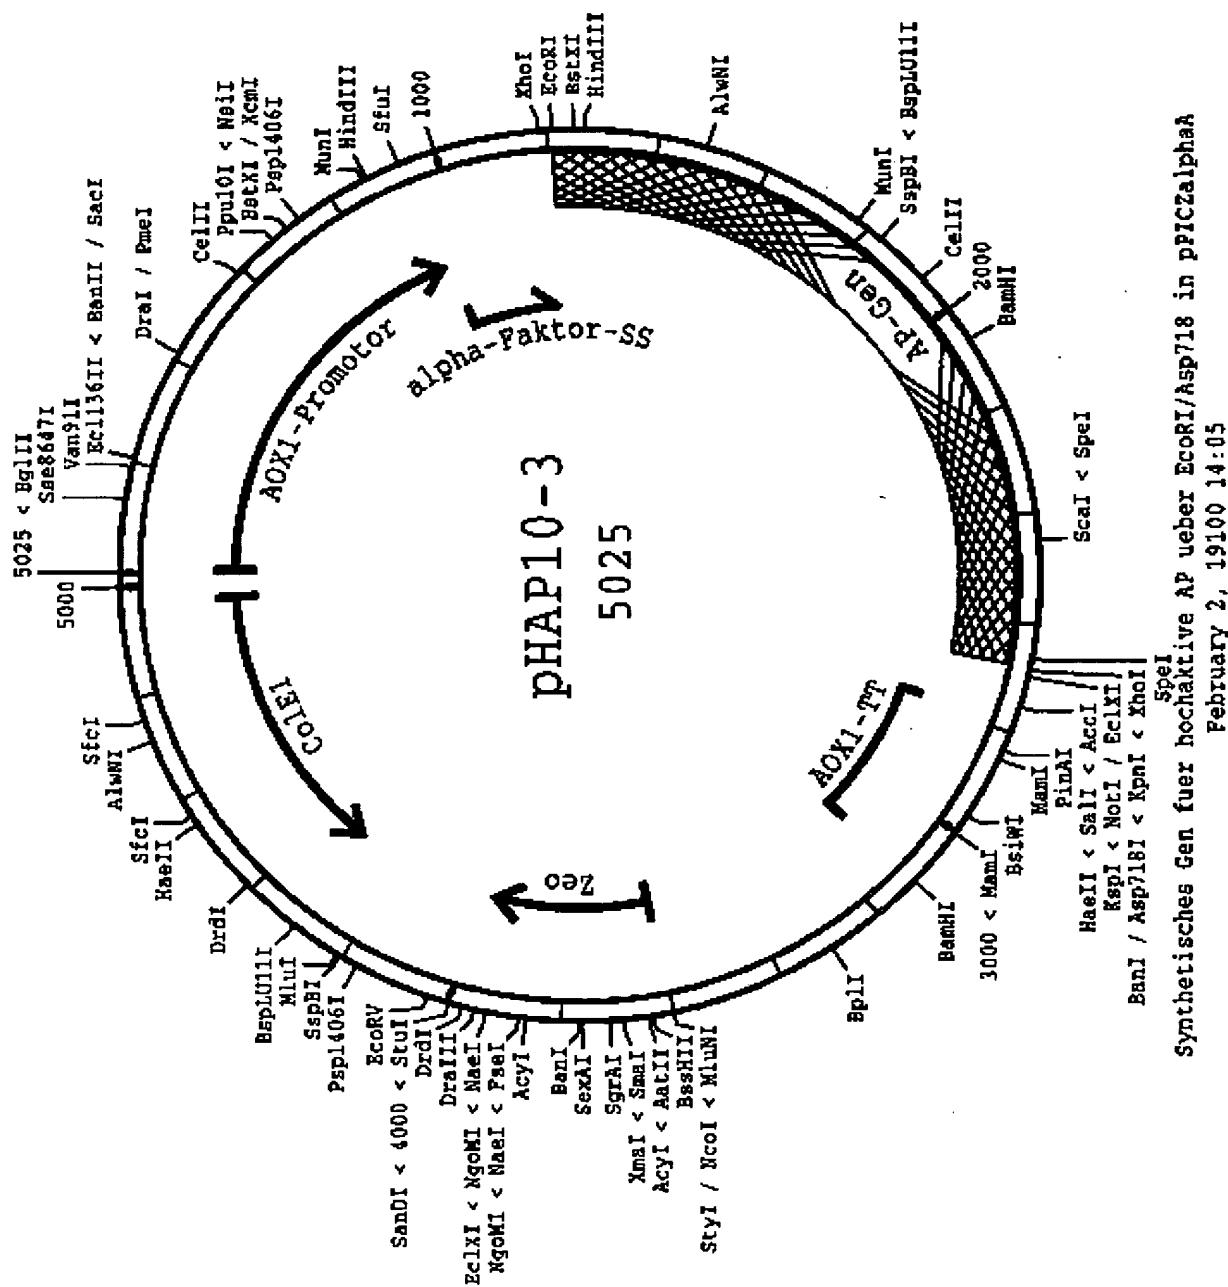


Fig. 2

APPROVED	O.G. FIG.
BY	
DRAFTSMAN	CLASS SUBCLASS

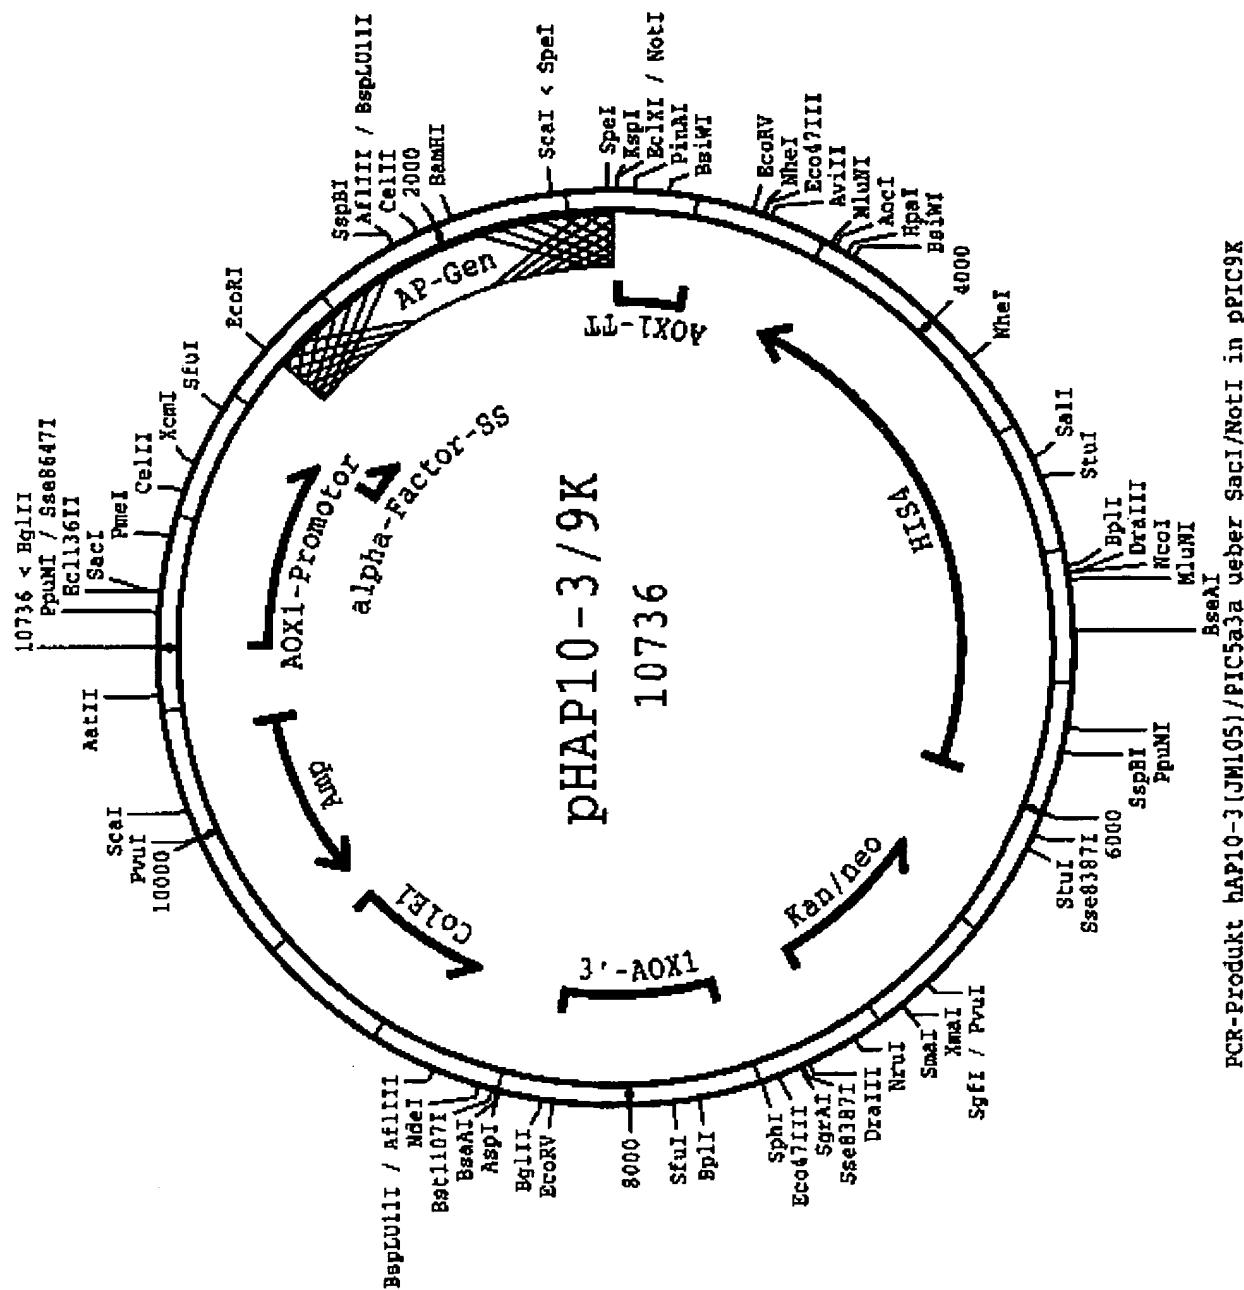

PCR-Produkt pHAP10-3 (JM105) / PIC5a3a ueber SacI/NotI in pPIC9K

Mismatch: 0 MinCuts = 1 MaxCuts: 2
With 198 enzymes: *

Fig. 3